

Joist Span


Based on No. 2 or better wood grades.
 (Design Load = 40#LL + 10#DL, Deflection= L/360)

	Ponderosa Pine			Southern Pine			Western Cedar		
	12"OC	16"OC	24"OC	12"OC	16"OC	24"OC	12"OC	16"OC	24"OC
2x6	9-2	8-4	7-0	10-9	9-9	8-6	9-2	8-4	7-3
2x8	12-1	10-10	8-10	14-2	12-10	11-0	12-1	11-0	9-2
2x10	15-4	13-3	10-10	18-0	16-1	13-5	15-5	13-9	11-3
2x12	17-9	15-5	12-7	21-9	19-0	15-4	18-5	16-0	13-0

Sample Calculations for Using Joist Span, Beam Size and Footing Size Tables

CASE I SOLUTION:

Refer to tables for joist, beam and footing size requirements.

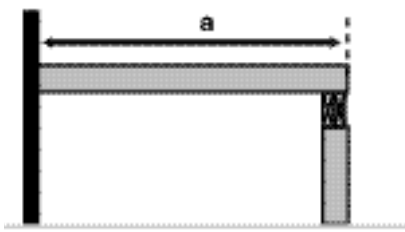


Example: a = 12'; Post Spacing = 8'

Use the Joist Span table to find the acceptable joist sizes for a 12' span, 2x8s at 12" O.C., 2x10s at 16" O.C. or 2x12s at 24" O.C.

Use the Beam and Footing Sizes table and find the 8' post spacing column. With a 12' deck span, the beam may be either two 2x8s or two 2x10s, depending on wood used. Depending on the type of soil, the footing diameter at the base must be a minimum of 12", 10" or 9" for the corner post and 17", 14" or 12" for all intermediate posts.

Use "a" to determine joist size and "a" + "2b" to determine beam and footing sizes. The length of "b" is restricted by both the length of "a" and the size of the joists.

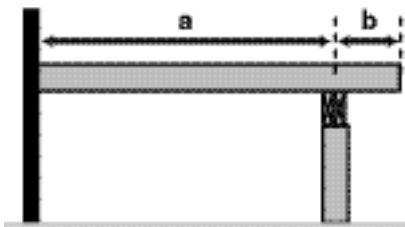


Example: a = 8', b = 2', Post Spacing = 10'

Refer to the Joist Span table. For an 8' joist span, either 2x8s at 24" O.C. or 2x6s at 16" O.C are acceptable.

For sizing the beam, use a joist length of 12' (8' + 4') and a post spacing of 10'. The Beam and Footing Sizes table indicates that the beam may be either two 2x10s or two 2x12s, depending on wood used. Depending on the type of soil, the footing diameter at the base must be a minimum of 15", 12" or 11" for the corner post and 20", 17" or 15" for all intermediate posts. Note that because of the 2' cantilever all footing sizes were increased by 1" as required by footnote 2 at the end of the table.

Use "a" or "b", whichever is greater, to determine joist size. Use "a" + "b" to determine the size of Beam 1 and the post footing size for the posts supporting Beam 1. Use joist length "b" to determine both the size of Beam 2 and the post footing size for the posts supporting Beam 2.

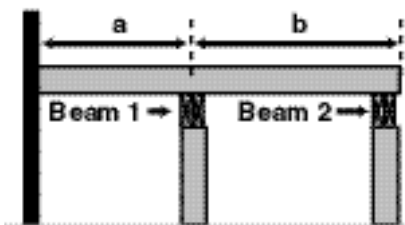

Example: a = 6', b = 7', Post Spacing = 9'

Joist size is determined by using the longest span joist (7'). The Joist Span table indicates that 2x6s at 24" O.C. would be adequate for this span.

For Beam 1 and footings, use a joist length of 13' (6' + 7') and a post spacing of 9'. The Beam and Footing Sizes table indicates that the beam may be two 2x10s or two 2x12s, depending on the wood used. Depending on the type of soil, the footing diameters for Beam 1 posts shall be 13", 11" or 9" for the corner (outside) post and 19", 15" or 13" for all intermediate posts. For Beam 2 and footings use a joist length of 7' and post spacing of 9'. The beam may be two 2x8s or two 2x10s, depending on wood used. Depending on the type of soil, the footing diameters for Beam 2 shall be 10", 8" or 7" for the corner posts, and 14", 11" or 10" for all intermediate posts. **V-39**

Beam and Footing Sizes

Based on No. 2 or better Ponderosa Pine and Southern Pine
(Treated for weather and/or ground exposure)

		Post Spacing											
		4'	5'	6'	7'	8'	9'	10'	11'	12'	13'	14'	
Joist Length	6'	Southern Pine Beam	1-2x6	1-2x6	1-2x6	2-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10
		Ponderosa Pine Beam	1-2x6	1-2x6	1-2x8	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10
		Corner Footing	6 5 4	7 6 5	7 6 5	8 7 6	9 7 6	9 7 6	10 8 7	10 8 7	10 9 7	11 9 8	11 9 8
	Intermediate Footing	9 8 7	10 8 7	10 9 7	11 9 8	12 10 9	13 10 9	14 11 10	14 12 10	15 12 10	15 13 11	16 13 11	
	7'	Southern Pine Beam	1-2x6	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12
		Ponderosa Pine Beam	1-2x6	1-2x6	1-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10
		Corner Footing	7 5 5	7 6 5	8 7 6	9 7 6	9 8 7	10 8 7	10 8 7	11 9 8	11 9 8	12 10 9	12 10 9
	Intermediate Footing	9 8 7	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	15 13 11	16 13 11	17 14 12	17 14 12	
	8'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12
		Ponderosa Pine Beam	1-2x6	2-2x6	2-2x8	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12
		Corner Footing	7 6 5	8 6 6	9 7 6	9 8 7	10 8 7	10 8 7	11 9 8	11 9 8	12 10 9	13 10 9	13 11 9
	Intermediate Footing	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	16 13 11	16 13 11	17 14 12	18 15 13	18 15 13	
9'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10	
	Ponderosa Pine Beam	1-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	
	Corner Footing	7 6 5	8 7 6	9 7 6	10 8 7	10 9 7	11 9 8	12 10 8	12 10 9	13 10 9	13 11 9	14 11 10	
Intermediate Footing	10 9 7	12 10 8	13 10 9	14 11 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 15 13	20 16 14		
10'	Southern Pine Beam	1-2x6	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10	
	Ponderosa Pine Beam	1-2x6	1-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Corner Footing	8 6 6	9 7 6	10 8 7	10 8 7	11 9 8	12 10 8	12 10 9	13 11 9	14 11 10	14 12 10	15 12 10	
Intermediate Footing	11 9 8	12 10 9	14 11 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15		
11'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Corner Footing	8 7 6	9 7 6	10 8 7	11 9 8	12 9 8	12 10 9	13 11 9	14 11 10	14 12 10	15 12 10	15 13 11	
Intermediate Footing	12 9 8	13 11 9	14 12 10	15 12 10	16 13 11	17 14 12	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15		
12'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x10	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x10	2-2x10	2-2x12	2-2x12	3-2x12	3-2x12	Eng Bm	Eng Bm	
	Corner Footing	9 7 6	10 8 7	10 9 7	11 9 8	12 10 9	13 10 9	14 11 10	14 12 10	15 12 10	15 13 11	16 13 11	
Intermediate Footing	12 10 9	14 11 10	15 12 10	16 13 11	17 14 12	18 15 13	19 16 14	20 16 14	21 17 15	22 18 15	23 18 15		
13'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x6	2-2x8	2-2x10	2-2x12	2-2x12	2-2x12	3-2x12	3-2x12	Eng Bm	Eng Bm	
	Corner Footing	9 7 6	10 8 7	11 9 8	12 10 8	13 10 9	13 11 9	14 12 10	15 12 10	15 13 11	16 13 11	17 14 12	
Intermediate Footing	13 10 9	14 12 10	15 13 11	17 14 12	18 15 13	19 15 13	20 16 14	21 17 15	22 18 15	23 19 16	24 19 17		
14'	Southern Pine Beam	1-2x6	2-2x6	2-2x6	2-2x8	2-2x10	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	3-2x12	
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm	
	Corner Footing	9 8 7	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	15 13 11	16 13 11	17 14 12	17 14 12	
Intermediate Footing	13 11 9	15 12 10	16 13 11	17 14 12	18 15 13	20 16 14	21 17 15	22 18 15	23 18 16	24 19 17	24 20 17		
15'	Southern Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x8	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm	
	Corner Footing	10 8 7	11 9 8	12 10 8	13 10 9	14 11 10	14 12 10	15 12 11	16 13 11	17 14 12	17 14 12	18 15 13	
Intermediate Footing	14 11 10	15 12 11	17 14 12	18 15 13	19 16 14	20 17 14	21 17 15	22 18 16	23 19 17	24 20 17	25 21 18		
16'	Southern Pine Beam	2-2x6	2-2x6	2-2x8	2-2x8	2-2x10	2-2x12	2-2x12	3-2x10	3-2x12	3-2x12	Eng Bm	
	Ponderosa Pine Beam	2-2x6	2-2x8	2-2x10	2-2x10	3-2x10	3-2x10	3-2x12	3-2x12	Eng Bm	Eng Bm	Eng Bm	
	Corner Footing	10 8 7	11 9 8	12 10 9	13 11 9	14 11 10	15 12 10	16 13 11	16 13 12	17 14 12	18 15 13	18 15 13	
Intermediate Footing	14 11 10	16 13 11	17 14 12	18 15 13	20 16 14	21 17 15	22 18 16	23 19 16	24 20 17	25 21 18	26 21 18		

Notes:

- Joist length is total length of joist, including any cantilevers.
- When joist extends (cantilevers) beyond support beam by 18" or more, add 1" to footing dimensions shown.
- Requirements for future 3-season porches or screen porches:
 - Increase corner footing size shown by 90%.
 - Increase center footing size shown by 55%.
 - Locate all footings at extremities of deck (no cantilevers).
 - Beam sizes indicated need not be altered.

- All footing sizes above are base diameters (in inches) and are listed for THREE SOIL TYPES:

